

Patriot Chimney INSPECTION FORM

CONTACT US:

701 Oak Dr. Blue Ridge, VA 24064 540-225-2626

www.patriotchimney.net

Customer:	
Address:	
City/St./Zip:	
Email:	
Date:	

Condition Report

		<u> </u>			
CHIMNEY					
Check where appropriate.	Satisfactory	Unsatisfactory	N/A		
Height					
Chimney Cap/Spark Arrestor					
Crown/Wash					
Brickwork/Mortar					
Flashing					
Flue Liner					
Moisture Resistance					
FIREPI	ACE	•			
Smoke Chamber					
Smoke Shelf					
Damper					
Lintel					
Firebox/Grate					
Firebrick					
Ash Container					
Spark Screen/Door					
Tools/Gloves					
Hearth Protection					
Misc.					
WOOD STOVE OR F	REPLACE	INSERT			
Stopepipe Condition					
NFPA Approved Flue Connection					
Installation/Thimbles/Clearances			П		
	_				
OTHER SAFETY CONSIDERATIONS					
Fire Ext/Smoke Detectors/CO Alarms					
Gas/Oil Furnace Flue Liner					
Fire Escape Plan					
	_	_			

By signing, you agree that Patriot Chimney Service, LLC has explained to you, and now fully understand the apparent condition of your fireplace, appliance, chimney, or vent system at this time.

Today's date:
Customer Signature:
Date:
Patriot Chimney Signature:
Date:

Fi	ren	lad	:0

• Masonary • Prefab Modular

Appliance:

•F-S Stove •Insert

Type of Fuel:

• Wood • Pellet o Oil

• Gas • Other Chimney:

• Masonary • Prefab Other

Liner:

•Stainless •Tile Unlined

Size:

°8"x8" °8"x13 °8"x17" °13"x13" °13"x17"

•6"R •8"R •10"R •12"R

Number of Stories:

Performed NFPA 211 Level _

• Cast

Other:

Other:

Other:


Other:

Other:

Other:

inspection (See back of form)

COMMENTS:

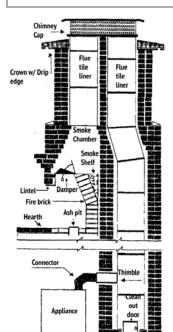

The National Fire Protection Association recommends an annual inspection of all fireplaces, chimneys, and vents. The next inspection of your system should take place on:

Furthermore, by signing, you understand that Patriot Chimney Service, LLC has performed a visual inspection and is not responsible for concealed or hidden defects. Patriot Chimney Service, LLC has discussed any visible defects and has recommended corrective actions. Since hidden defects and conditions of use are beyond the control of Patriot Chimney Service, LLC, you understand no guarantee or warranty of fire safety of any appliance is given or implied.







NATIONAL FIRE PROTECTION ASSOCIATION CHIMNEY INSPECTION LEVELS

CONTACT US:

701 Oak Dr. Blue Ridge, VA 24064 540-225-2626

www.patriotchimney.net

Patriot Chimney Service, LLC performs chimney inspections that meet the standards established by the National Fire Protection Association (NFPA).

The 2000 edition of the NFPA 211, Standards for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances identifies three levels of chimney inspection, and when each level of inspection should be performed.

	Scope	Required Access	Occasion	Indications
LEVEL 1	Basic condition of chimney and flue Absence of combustible deposits or blockage in flue Accesible areas of appliance & connector	Readily accessible areas of the chimney interior and exterior. Accessible portions of hte appliance and chimney connector	Annually During routine chimney sweeping Upon replacement of connected appliance with a similar unit	When verification of serviceability for continued use under present conditions is needed
LEVEL 2	A Level 1 Inspection and: Accessible portions of the chimney structure and all enclosed flues, including size and suitability of flues Proper clearances to combustibles	All accessible areas, interior and exterior, including parts of the chimney passing through crawlspaces and attics Shall include video scan and other means of flue interior visual inspection	Adding or removing an appliance; replacing an appliance with on of a different type of fuel. After an event likely to cause damage and before relining A real estate sale or transfer	Verification of chimney serviceability for continued service under changing conditions, or a level 1 inspection is inadequate
LEVEL 3	Concealed areas of the chimney structure and enclosed flues. Clearances from combustibles chine	Designated parts of the chimney structure and the building, including concealed areas. Removal of parts of the chimney or building as needed to gain access to specific concealed areas	As needed to examine damage to the chimney or building. When a lower level inspection results in detected or suspected hazard that can't be checked without access to concealed areas	When knowledge of the condition of the chimney is critical to the renewed or continued use of the chimney. Required only for areas of concern that can't be properly evaluated by a lower level inspection

Readily Accessible - Exposed or capable of being exposed for operation, inspection, or maintenance without the use of tools or ladders

Accessible - Exposed or capable of being exposed for operation, inspection, or maintenance with the use of common tools without damage to the chimney structure, building, or finished surfaces.

Concealed - Not capable of being exposed for operation, inspection, or maintenance without the use of special tools or without damage to the chimney structure, building, or finished surfaces.





